

CUSTOMER SERVICE INSPECTION

A CUSTOMER SERVICE INSPECTION IS REQUIRED WITHIN 10 DAYS FROM THE TIME OF SERVICE BEING CONNECTED OR TRANSFERRED. IF YOU DO NOT HAVE AN INSPECTION YOUR WATER SERVICE WILL BE DISCONNECTED.

TO BE IN COMPLIANCE WITH TITLE 30 OF THE TEXAS ADMINISTRATIVE CODE CHAPTER 290 PUBLIC DRINKING WATER ACT, YOU ARE REQUIRED TO ADHERE TO THE FOLLOWING:

- VACUUM BREAKERS ON ALL OUTSIDE FAUCETS
- ANTI-SIPHON BALLCOCK IN COMMODOES AND PROPER WATER LEVELS
- SINKS AND TUBS MUST HAVE A MINIMUM AIR GAP OF 1" BETWEEN FAUCET AND TOP OF SINK OR TUB
- HOT WATER HEATERS MUST HAVE A 1" AIR GAP TO DRAIN LINE
- NO CONNECTION CAN EXIST WHICH WOULD ALLOW THE RETURN OF WATER USED FOR CONDENSING, COOLING OR INDUSTRIAL PROCESSES BACK TO THE PUBLIC WATER SUPPLY
- MUST HAVE BACKFLOW PREVENTION ON LAWN IRRIGATION SYSTEMS, SWIMMING POOLS AND FIRE SPRINKLER SYSTEMS
- MUST HAVE ANTI-SIPHON VALVE ON ALL WATER TROUGHS
- NO CROSS CONNECTION TO ANY WELL OR ANY OTHER SOURCE OF WATER
- ANY HOUSE BUILT AFTER JULY 1ST, 1988 CANNOT HAVE ANY SOLDER OR FLUX WHICH CONTAINS MORE THAN 0.2% LEAD IN PRIVATE PLUMBING FACILITIES OR PIPE OR FITTING WHICH CONTAINS MORE THAN 8.0% LEAD
- DISHWASHER DRAIN MUST BE UP TO THE UNDERNEATH SIDE OF THE COUNTERTOP, FACTORY VENT OR CHECK VALVE

ANY ONE OF THESE ITEMS NOT IN COMPLIANCE WILL RESULT IN A FAILED INSPECTION.

SOMEONE OVER THE AGE OF 18 MUST BE PRESENT AT THE TIME OF THE INSPECTION TO SHOW YOUR PRIVATE PLUMBING FACILITIES, ANSWER QUESTIONS, AND BE GIVEN ANY INSTRUCTIONS ON A FAILED INSPECTION.




Jones Water Supply Corporation
1650 N. STATE HWY 37
Quitman, Texas 75783-9646
903-967-2840

IRRIGATION SYSTEMS


Texas commission on Environmental Quality (TCEQ) rules, 30 TAC Chapter 344, requires a Reduced Pressure Zone backflow prevention assembly (RPZ) be installed on all irrigation systems where there is an on-site sewage facility (OSSF)

If you have an aerobic or septic system and an irrigation system, you must have an RPZ properly installed and tested by a person licensed by the State of Texas. Because irrigation systems are connected to the public water system, there is a potential for contamination to backflow into the water system. Commercial and residential lawn sprinkler systems typically have recessed sprinkler heads, which can become inundated with water. Water from the lawn is frequently exposed to fertilizers, chemicals and animal feces. These contaminants can be siphoned through leaking valves back into the potable water system and will prevent back siphonage of these contaminants into the household on the property.

An RPZ must be inspected upon installation and then annually by a person holding a Backflow Prevention Assembly Testers (BPAT) license. More information on this can be found at www.tceq.state.tx.us.

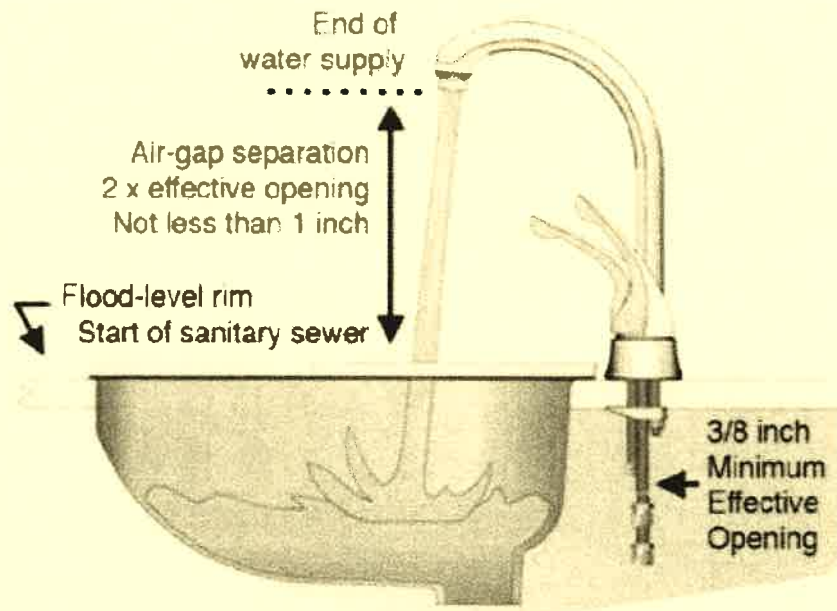

**FIGURE 801.2B
WATER DISTRIBUTION AIR GAP**

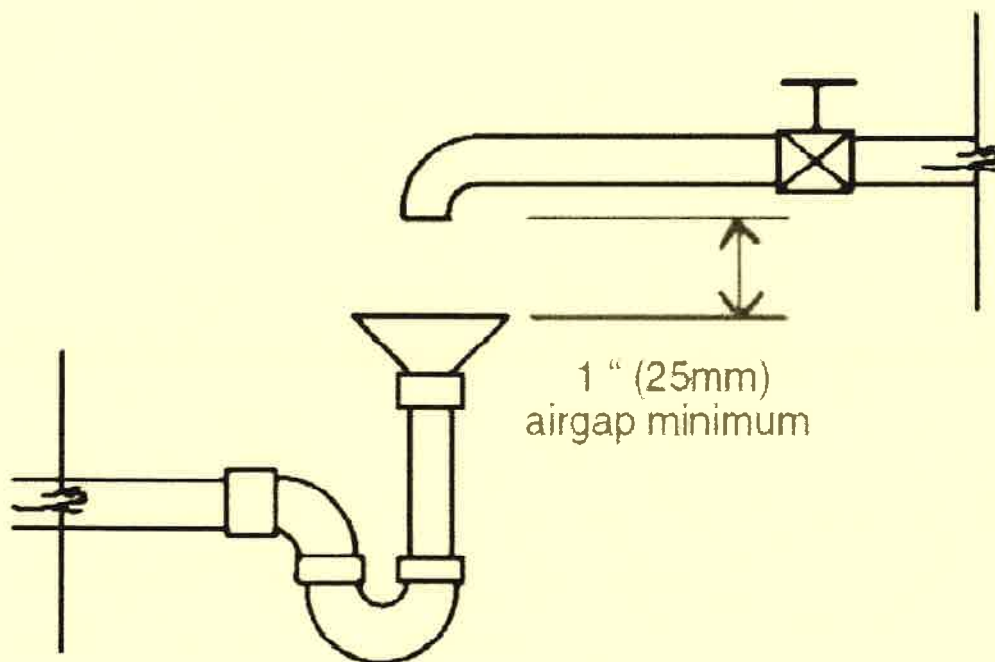


**FIGURE 801.2C
DRAINAGE AIR GAP**

The 2015 Uniform Plumbing Code Illustrated Training Manual eBook is [available for purchase here](#).



Dishwasher

Drain requirements


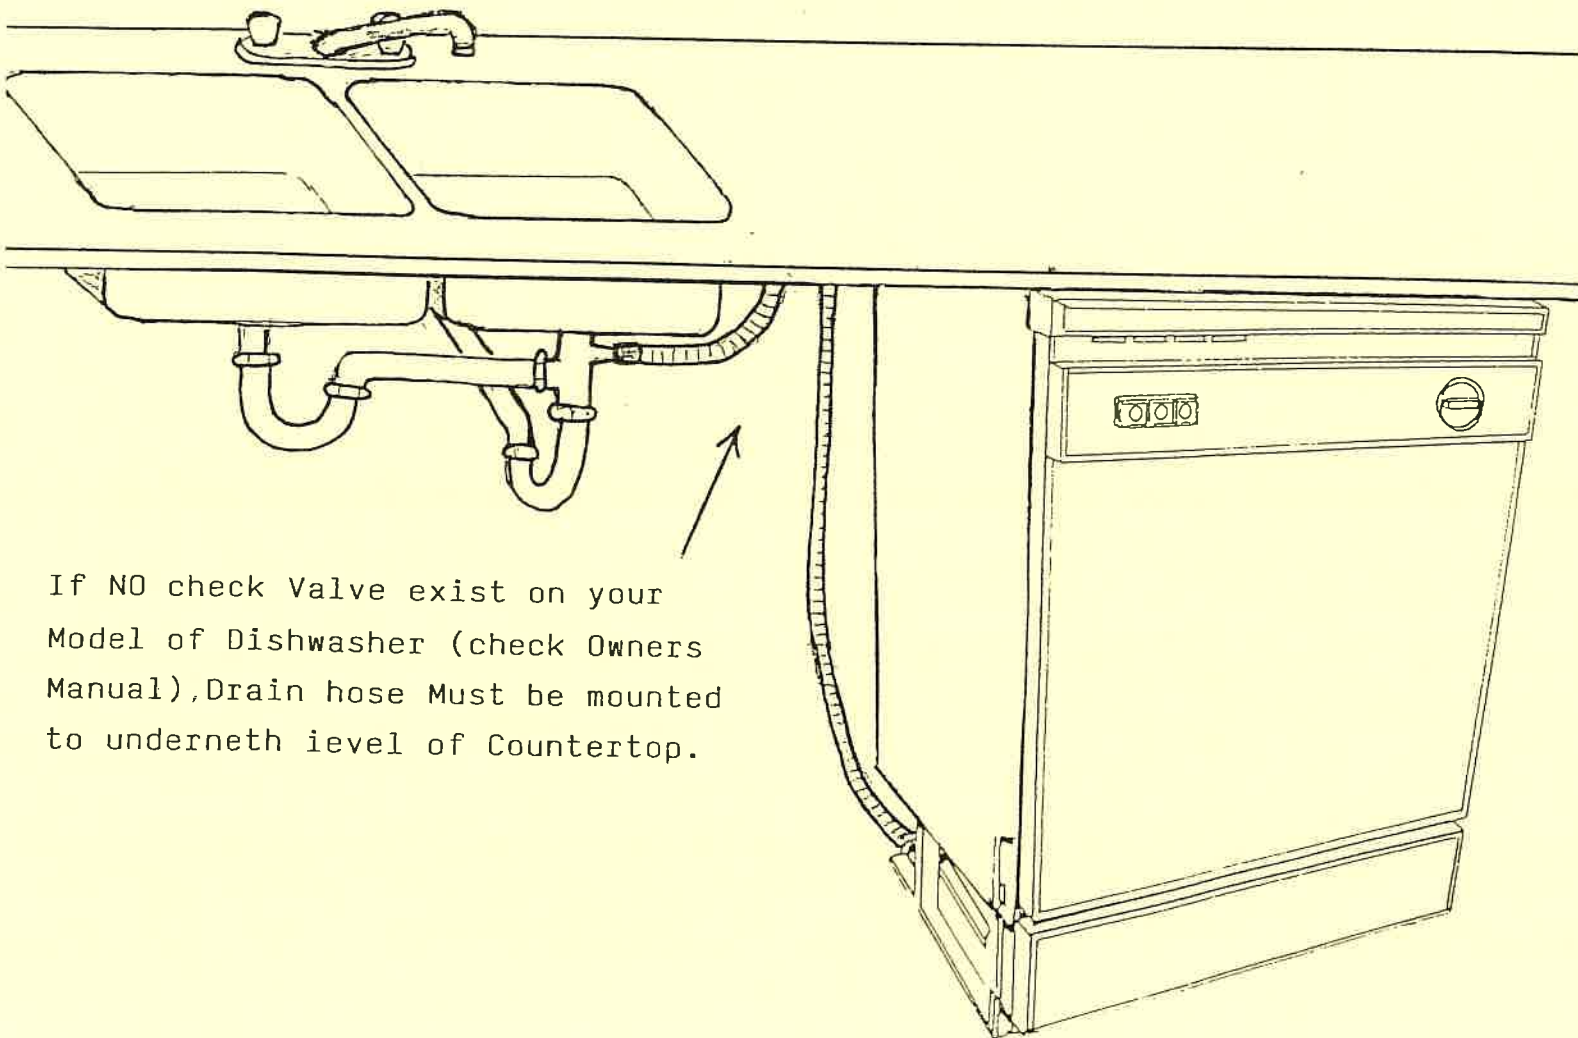


If NO check Valve exist on your Model of Dishwasher (check Owners Manual), Drain hose Must be mounted to underneth ievel of Countertop.

Sinks + Bathtubs

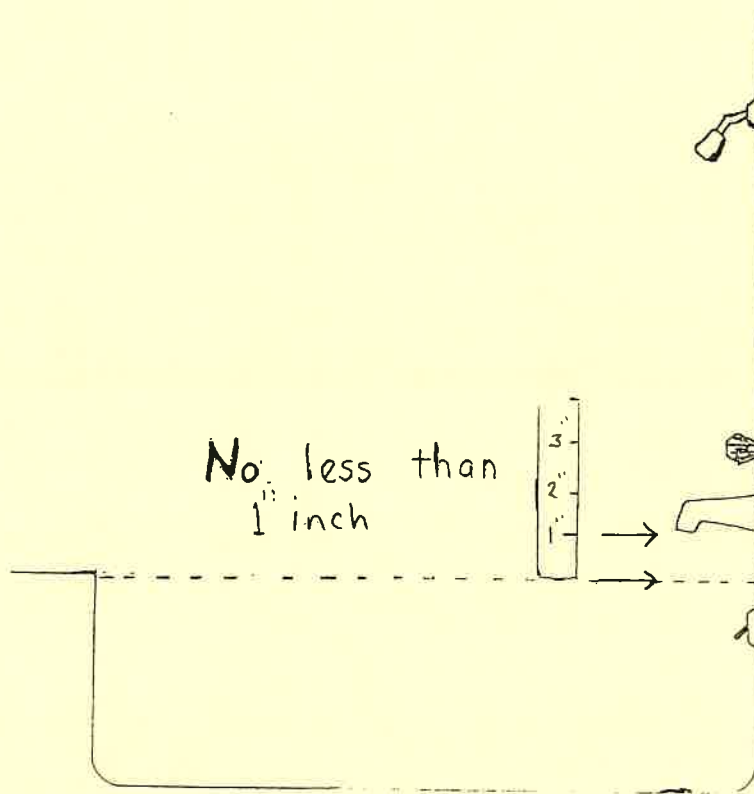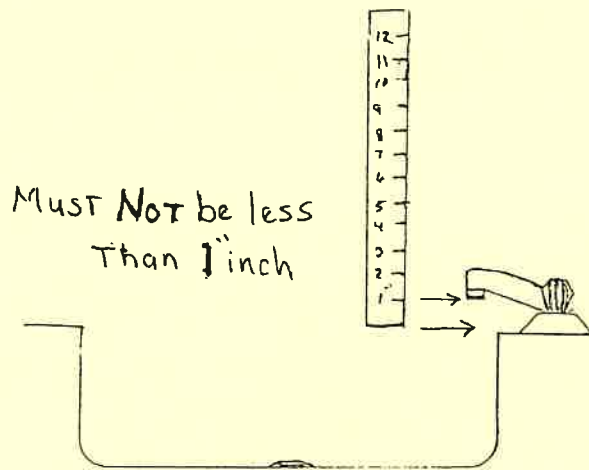





Toilet Tank Parts + Installation INSPECTION

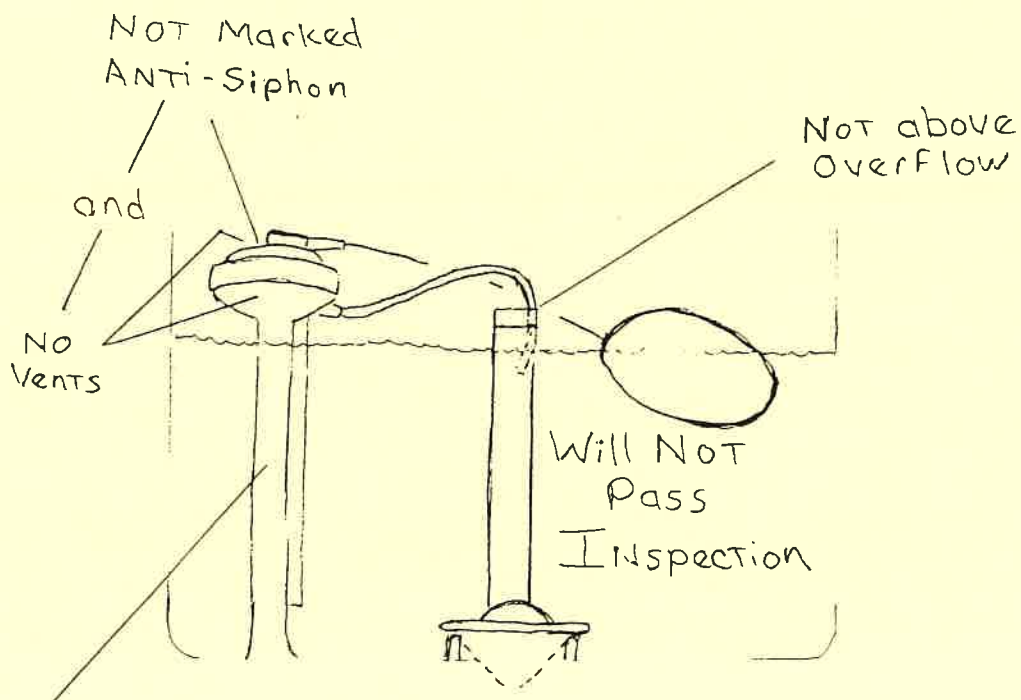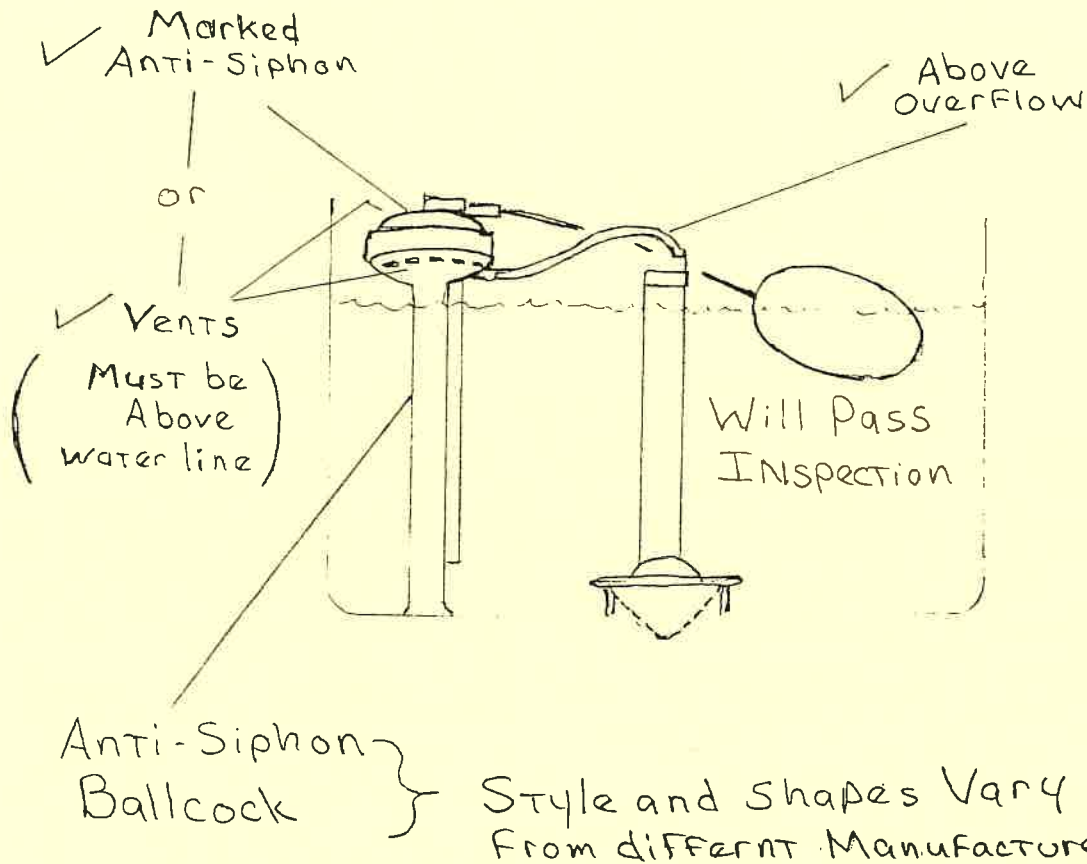

IS NOT Anti Siphon
Ballcock

Inless Specified by Manufacture's Packaging } → To be supplied at Time of Inspection

Common Hazards

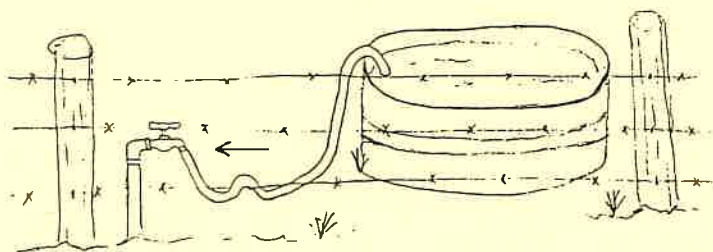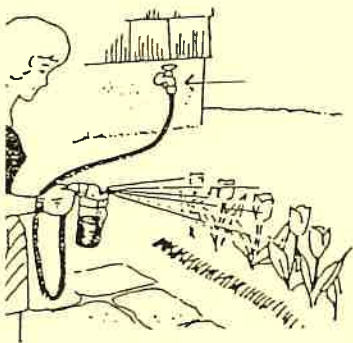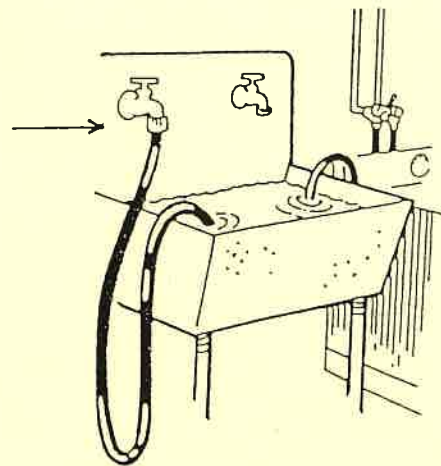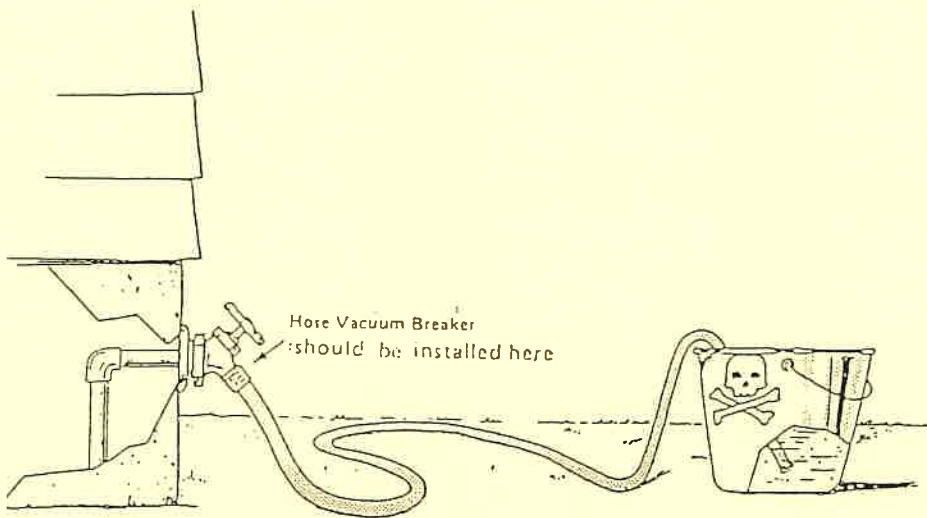

Hose Bibb Vacuum Breaker

